


ISOMETRIC VIEW

NOTE:
TOP LAYER OF JOINT REINFORCEMENT
TIES SHALL BE WITHIN 12" OF TOP
OF MASONRY

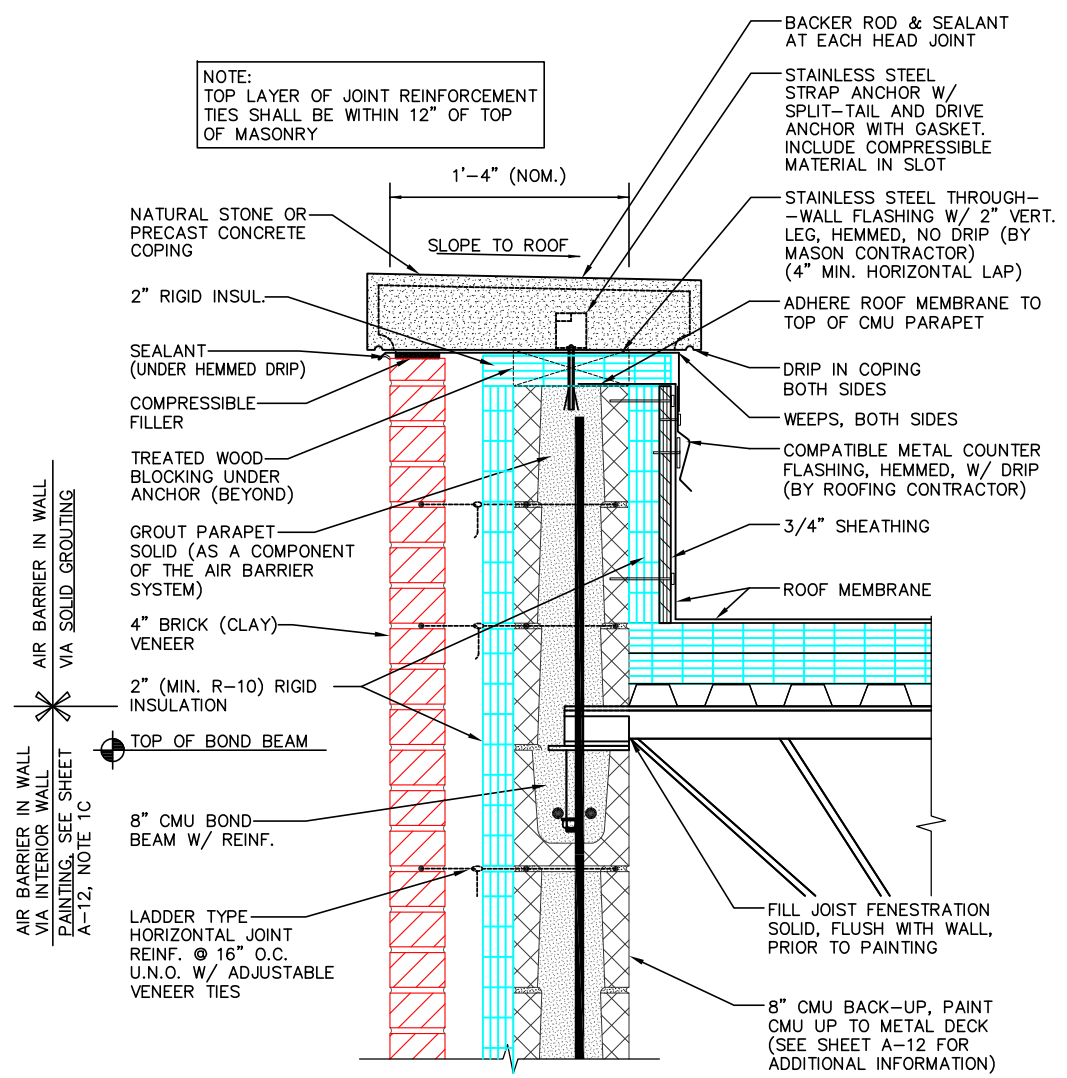

SECTION VIEW

AIR BARRIER IN WALL
VIA INTERIOR WALL
PAINTING, SEE SHEET
A-12, NOTE 1C

AIR BARRIER IN WALL
VIA SOLID GROUTING

10A
A-2

STONE / PRECAST
COPING PARAPET DETAIL

2" RIGID INSULATION

DAILEY ENGINEERING, INC.
8485 STEPHENSON ROAD
ONSTED, MI 49266

PH. # (517) 467-9000
FAX # (517) 467-9010

111 MASONRY
Institute of Michigan

DETAIL SET MW.8.RB.2 (2" HIGH PERFORMANCE CAVITY WALL)

IN CHARGE:	MIM
DRAWN:	M.W.F.
APPROVED:	T.A.D.
DATE:	11/04/2014
TITLE:	STONE/PRE-CAST COPING PARAPET DETAIL
SHEET:	A-11.1

The decision to utilize this information is not within the purview of the MIM, and persons making use of this information do so at their own risk. MIM makes no representation or warranties, expressed or implied, with respect to the accuracy or suitability of this information. MIM and its members disclaim liability for damages of any kind, including any special, indirect, incidental, or consequential damages, which may result from the use of this information. This information is not to be interpreted as indicating compliance with, or waiver of, any provision of any applicable building code, ordinance, standard or law.